
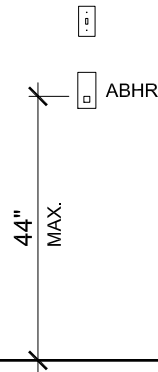



IF ABHR IS NEXT TO POTENTIAL IGNITION SOURCE, IT MUST BE OFFSET 1" HORIZONTALLY.

ABHR CANNOT BE ABOVE POTENTIAL IGNITION SOURCE.

ABHR CAN BE BELOW POTENTIAL IGNITION SOURCE, NO ISSUES.

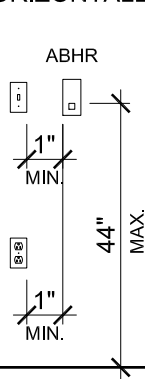

FLOOR

ALCOHOL BASED HAND RUB SANITIZERS MOUNTING REQUIREMENTS

LEGEND

- ABHR ALCOHOL BASED HAND RUB SANITIZER DISPENSER
- LIGHT SWITCH/RECEPTACLE OR OTHER POTENTIAL IGNITION SOURCE

NOTES

1. NO PROJECTION CAN EXTEND OUT MORE THAN 4" INTO CORRIDOR OR WALKWAY.
2. ALCOHOL BASED HAND RUB SANITIZERS CANNOT BE LOCATED ABOVE A POTENTIAL IGNITION SOURCE
3. ABHR MUST BE OFFSET A MINIMUM OF 1" HORIZONTALLY FROM ANY LIGHT SWITCH, ELECTRICAL OR DATA RECEPTACLE, THERMOSTAT OR OTHER POTENTIAL IGNITION SOURCE.
4. ABHR SANITIZERS CANNOT BE INSTALLED IN A CORRIDOR LESS THAN 6' WIDE
5. ABHR MUST BE AT LEAST 4' APART
6. ABHR CANNOT BE INSTALLED OVER CARPET IN NON-SPRINKLED SPACES.
7. MAX. CAPACITY OF INDIVIDUAL DISPENSERS IN CORRIDORS: 0.3 GALLONS
8. MAXIMUM OF 10 GALLONS TOTAL IS PERMITTED TO BE DISTRIBUTED THROUGHOUT ONE SMOKE COMPARTMENT OR FIRE AREA OUTSIDE OF A STORAGE ROOM. ONE DISPENSER PER ROOM CAN BE OMITTED FROM THE CALCULATION. WHERE A NUMBER OF DISPENSERS ARE STORED IN ONE SUPPLY ROOM, THE TOTAL MUST BE LIMITED TO UNDER FIVE GALLONS.

